


Project:

Order No: Premio EPS80 Compression
Part No: P80/2/2_2018_08_01(2)
Customer: Grip-Engineering

Tester: Thümler GmbH-Z5
Method: Compression test
Execution date: 2018. 08. 01. 8:06:03

Chart:

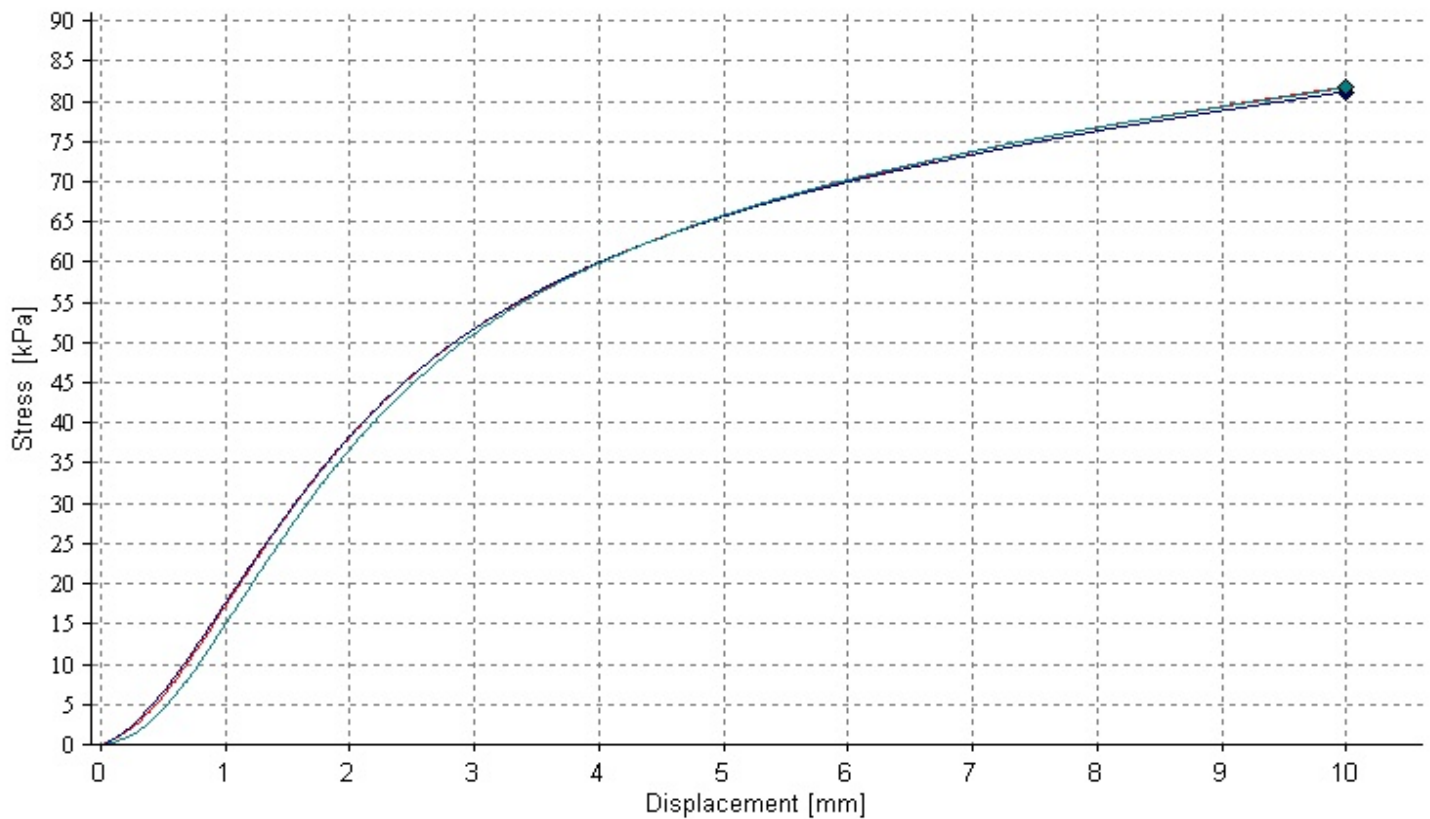

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2/2_2018_08_01(2)	81,78	9,99
P80/3/2_2018_08_01(3)	81,18	10,00
P80/3/2_2018_08_01(4)	81,68	9,99
Max.	81,78	10,00
Min.	81,18	9,99
Mean	81,54	9,99