

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2019_04_17


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2019. 04. 17. 17:21:55

Chart:

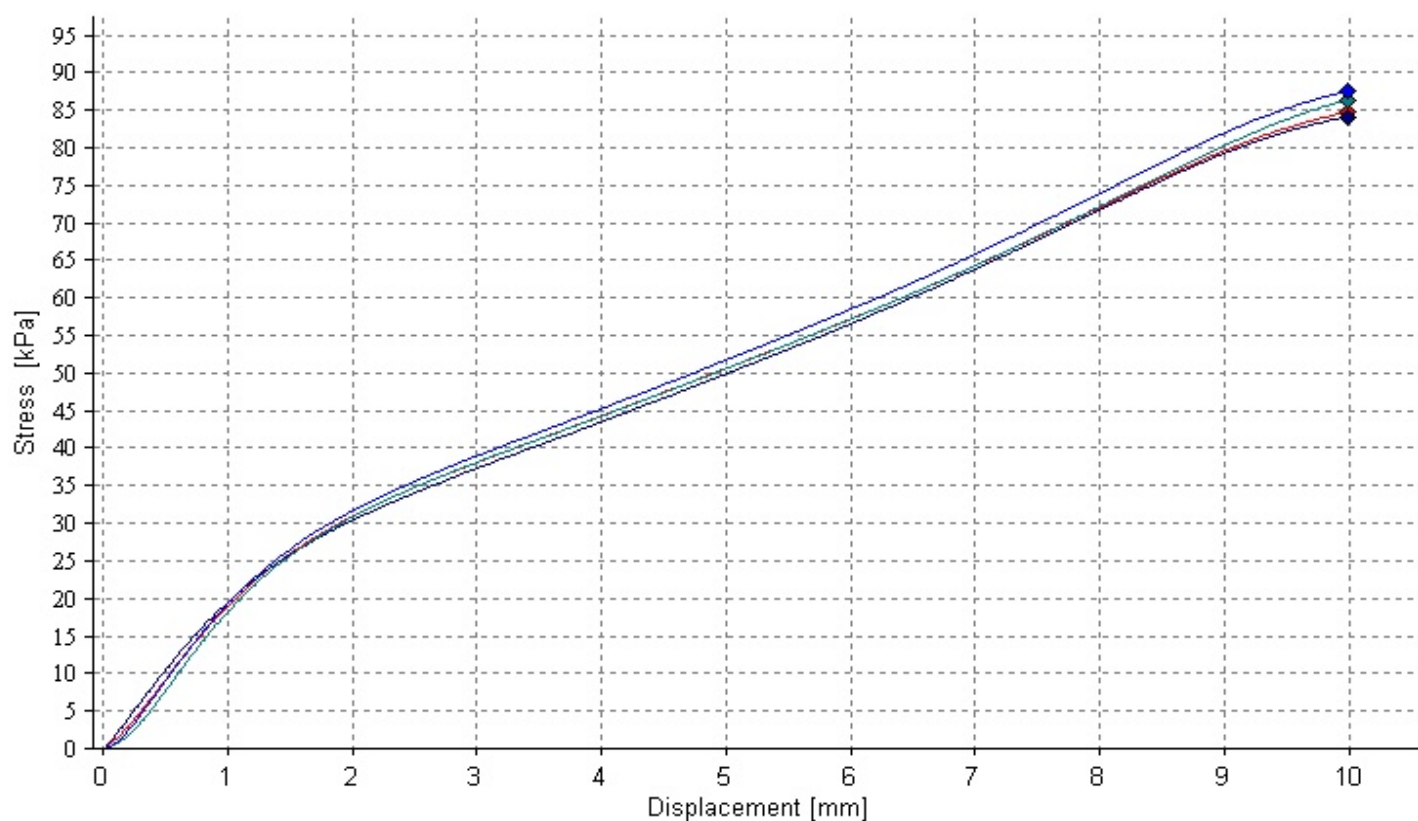

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2019_04_17 (1)	84,78	9,99
P80/2019_04_17 (2)	84,14	9,99
P80/2019_04_17 (3)	86,41	9,99
P80/2019_04_17 (4)	87,56	9,99
Max.	87,56	9,99
Min.	84,14	9,99
Mean	85,72	9,99