

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2019_05_03


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2019. 05. 03. 17:39:31

Chart:

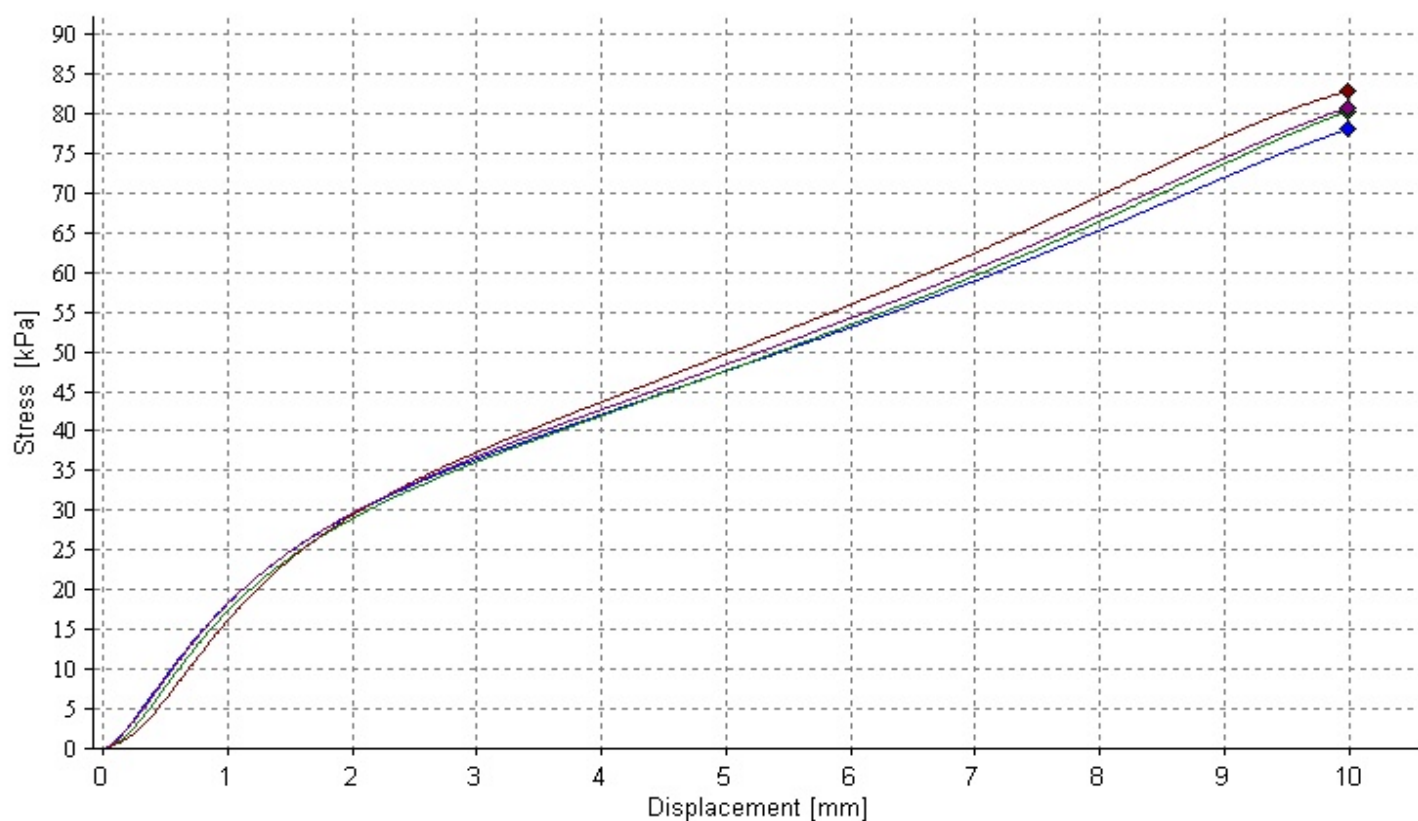

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2019_05_03 (4)	77,99	9,99
P80/2019_05_03 (5)	80,29	9,99
P80/2019_05_03 (6)	82,85	9,99
P80/2019_05_03 (7)	80,71	9,99
Max.	82,85	9,99
Min.	77,99	9,99
Mean	80,46	9,99