

Project:

Order No: Premio EPS100 Compression test

Part No: P100/2019_10_25(1)


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2019. 10. 25. 14:57:51

Chart:

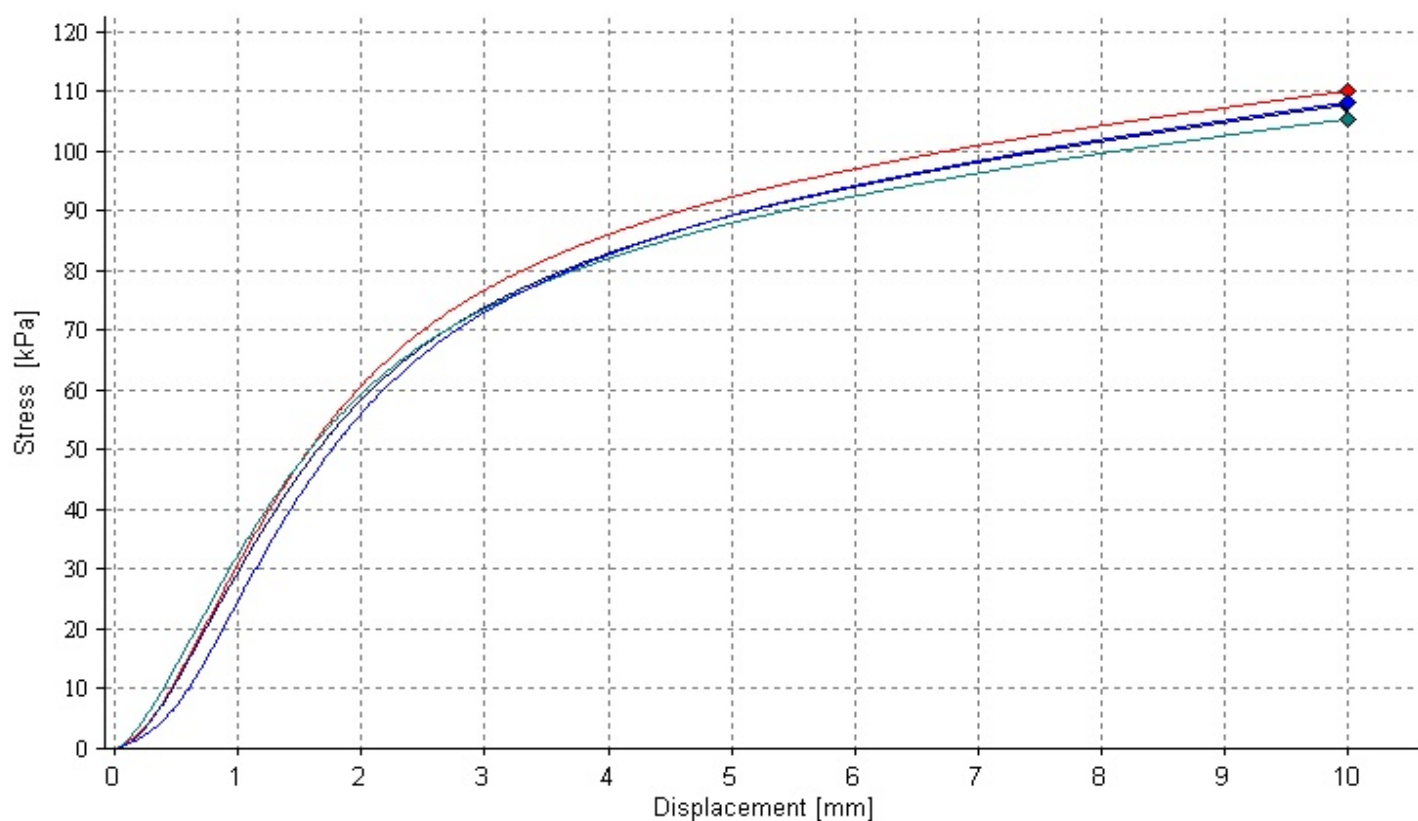

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P100/2019_10_25(1)	110,05	10,00
P100/2019_10_25(2)	107,70	9,99
P100/2019_10_25(3)	105,36	9,99
P100/2019_10_25(4)	108,15	10,00
Max.	110,05	10,00
Min.	105,36	9,99
Mean	107,81	9,99