

Project:

Order No: Premio EPS80 Compression test

Part No: P80/2020_09_08


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2020. 09. 08. 9:44:19

Chart:

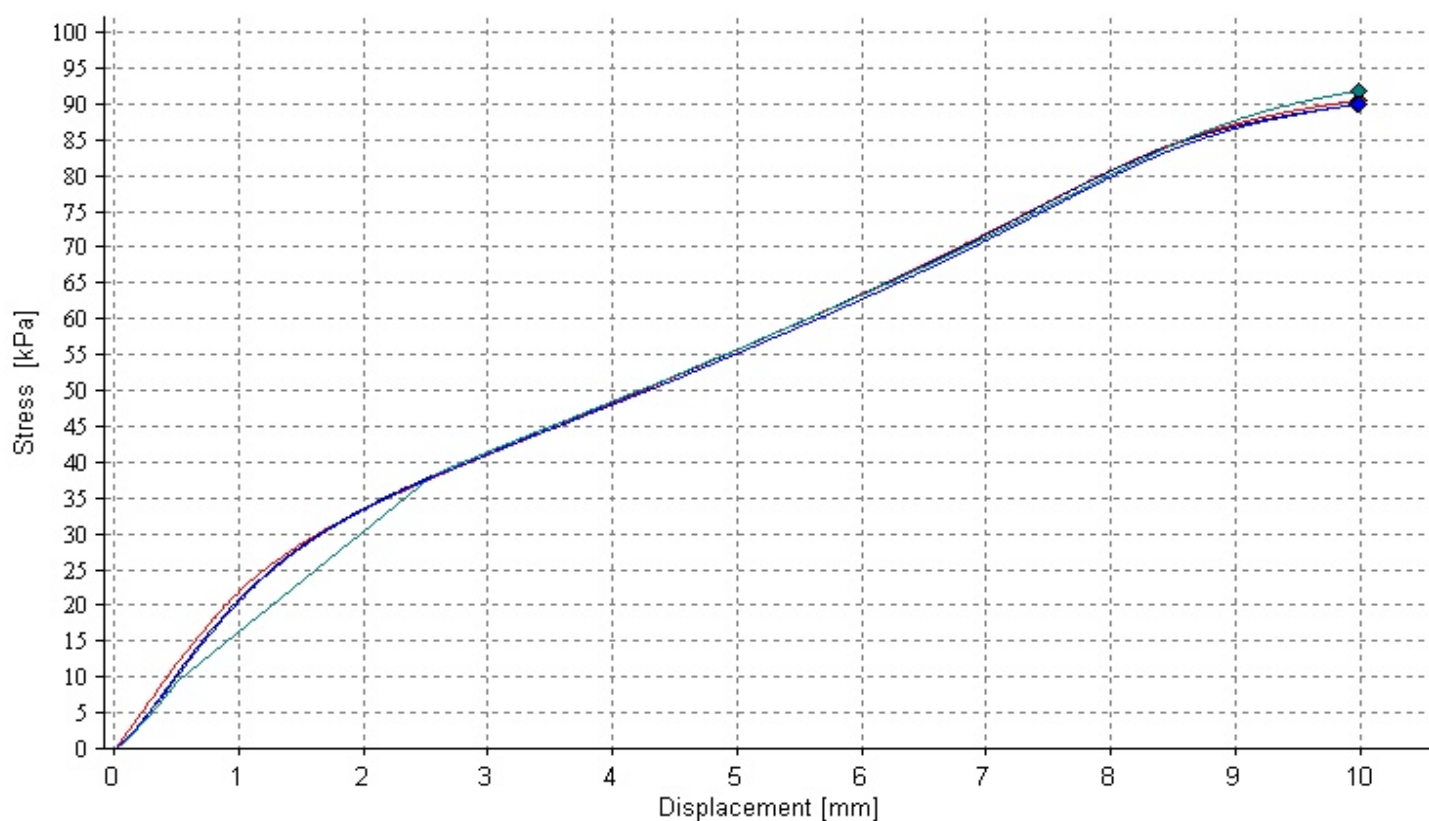

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
P80/2020_09_08 (1)	90,53	9,99
P80/2020_09_08 (2)	89,95	9,98
P80/2020_09_08 (3)	91,82	9,98
P80/2020_09_08 (4)	89,96	9,99
Max.	91,82	9,99
Min.	89,95	9,98
Mean	90,56	9,99