

Project:

Order No: Premio EPS100 Compression test

Part No: P100/2021_05_10


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2021. 05. 10. 12:14:22

Chart:

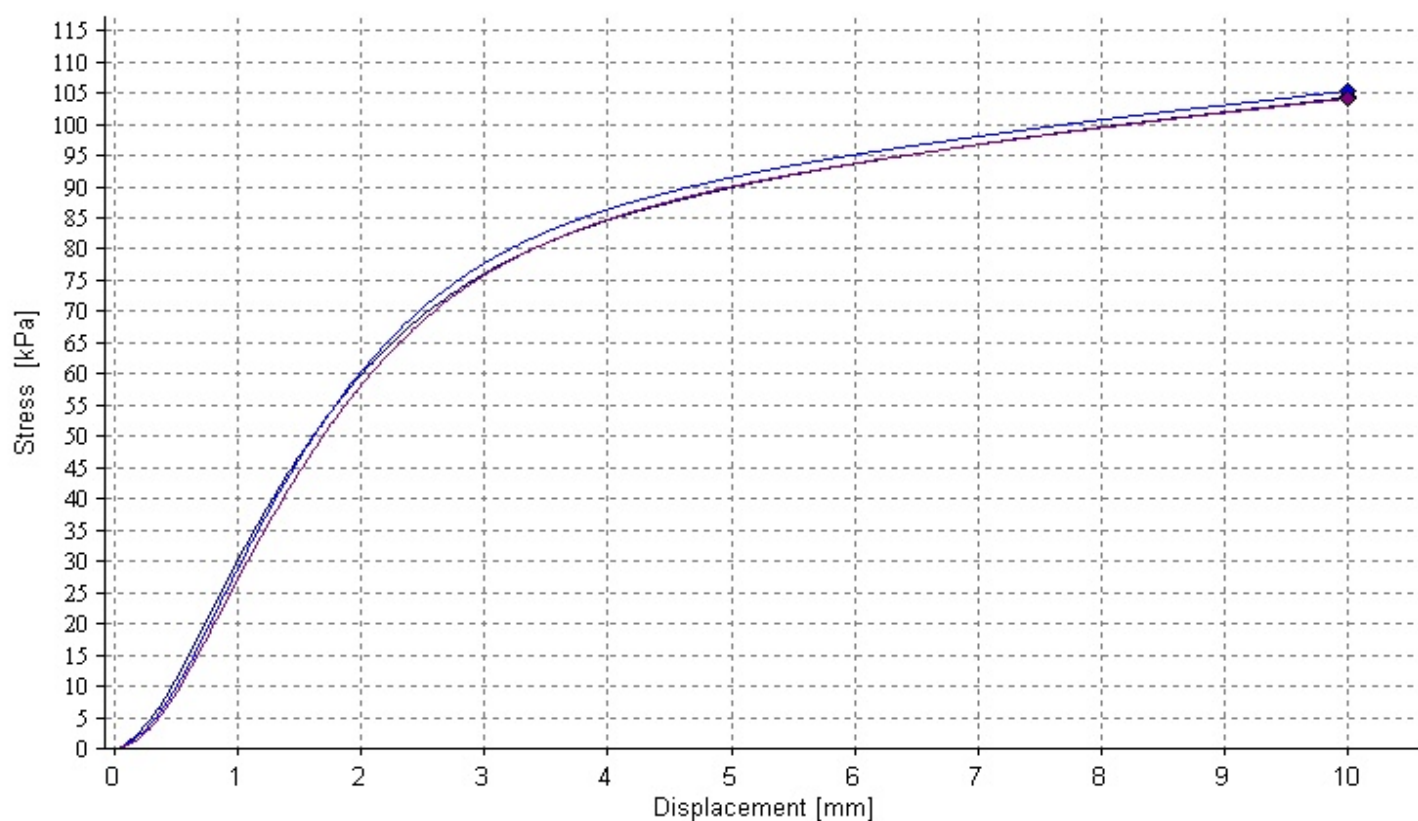

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
Premio EPS100/2021_0 5_10(2)	104,31	9,99
Premio EPS100/2021_0 5_10(4)	105,33	9,99
Premio EPS100/2021_0 5_10(8)	104,16	10,00
Max.	105,33	10,00
Min.	104,16	9,99
Mean	104,60	9,99