

Project:

Order No: Premio EPS80 Compression test

Part No: Premio EPS80/2021_06_10(1)


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2021. 06. 10. 9:21:33

Chart:

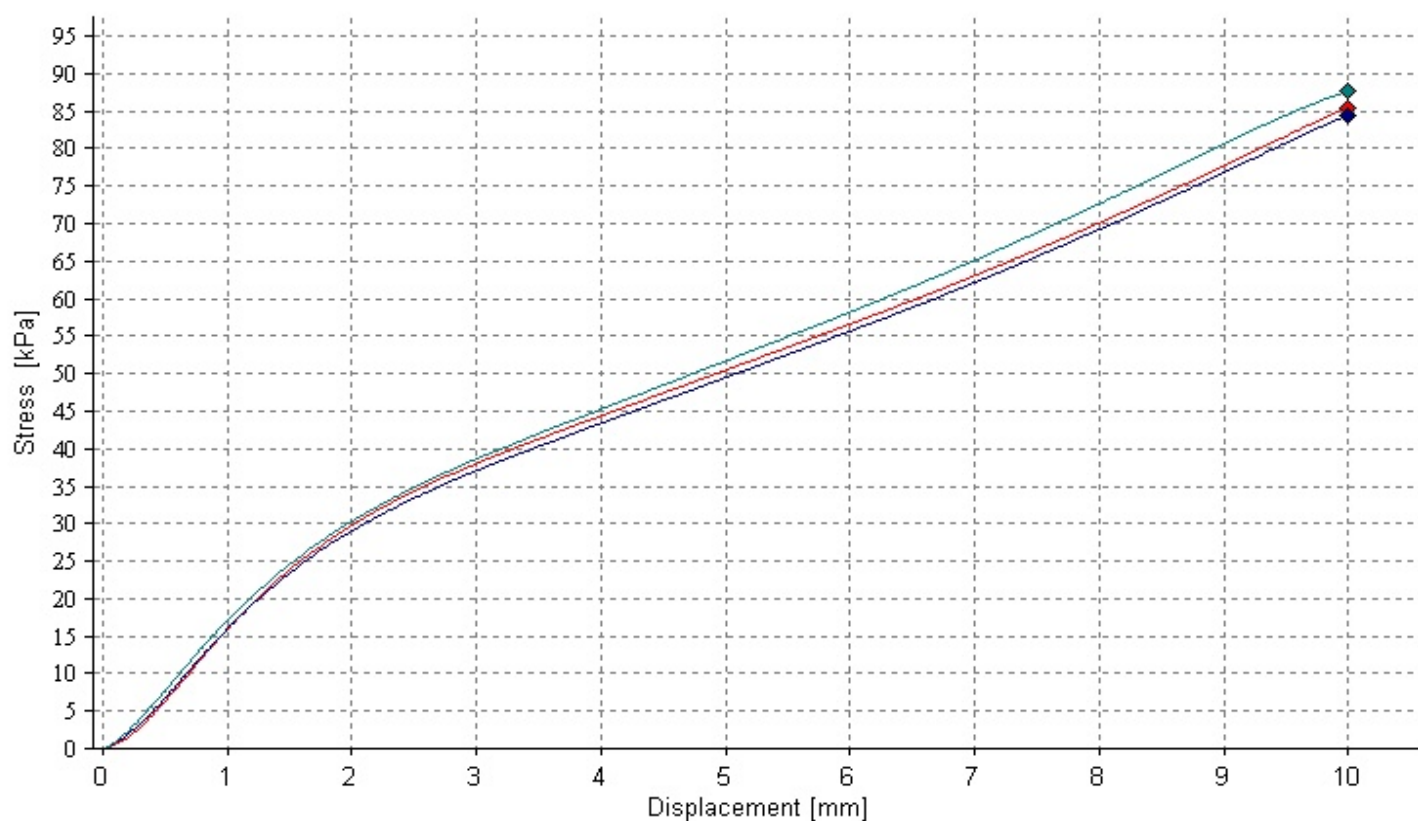

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
Premio EPS80/2021_06 _10(1)	85,53	9,99
Premio EPS80/2021_06 _10(2)	84,44	9,99
Premio EPS80/2021_06 _10(3)	87,70	10,00
Max.	87,70	10,00
Min.	84,44	9,99
Mean	85,89	9,99