

Project:

Order No: Premio EPS100 Compression test

Part No: Premio EPS100/2021_11_12


Customer: Premio Hungária

Tester: Thümler GmbH-Z5

Method: MSZ EN 826

Execution date: 2021.11. 12. 17:17:52

Chart:

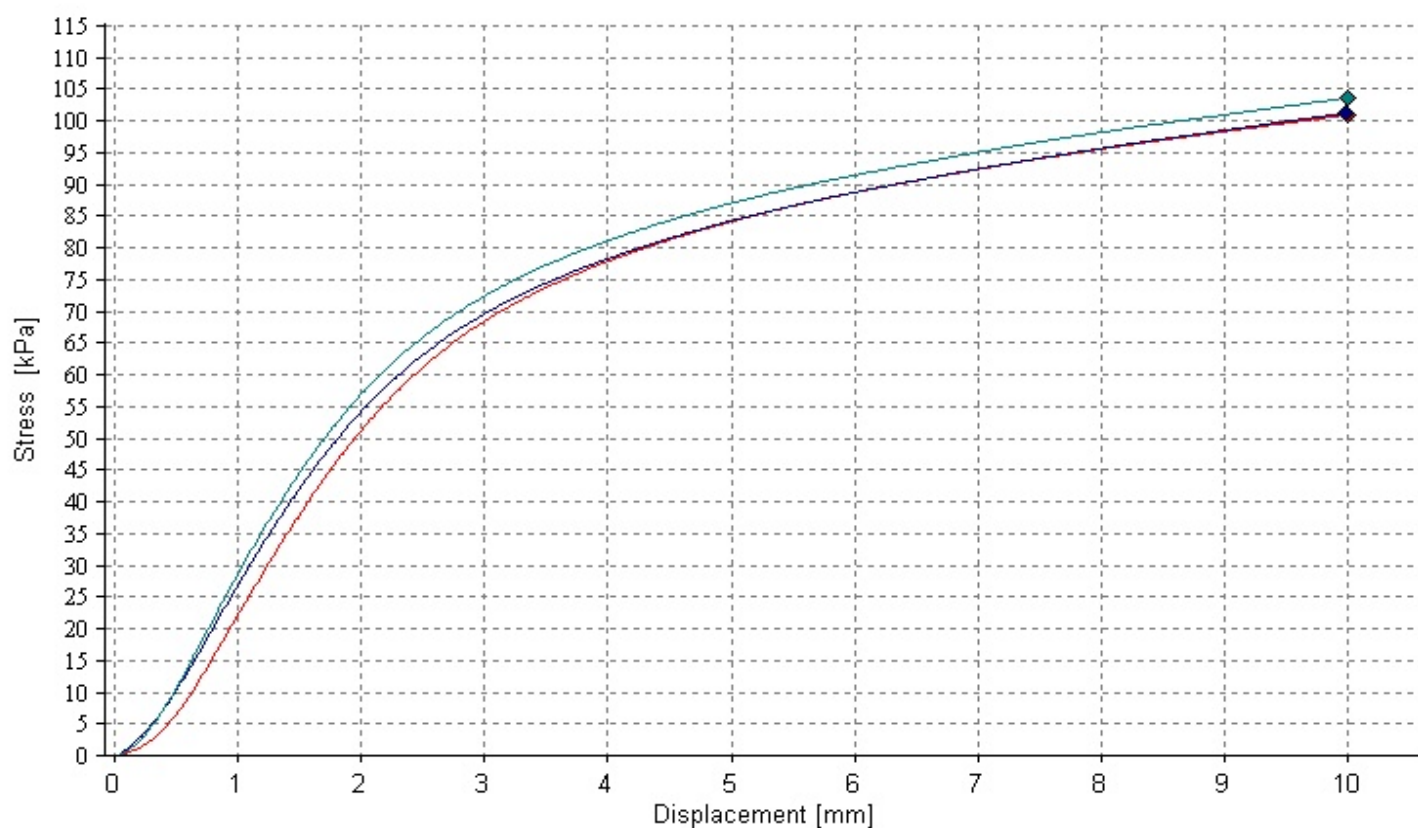

Results:

Nom	Stress [kPa] ,max.	Displacement [mm] ,max.
Premio EPS100/2021_1 1_12(1)	100,97	10,00
Premio EPS100/2021_1 1_12(2)	101,24	9,98
Premio EPS100/2021_1 1_12(3)	103,62	9,99
Max.	103,62	10,00
Min.	100,97	9,98
Mean	101,94	9,99